NOTES:

1. THE SURFACE SHALL BE ROUGH BROOM FINISH.
2. THERE SHALL BE A 12" WIDE BORDER OF 1/4" GROOVES SPACED AT APPROX. 3/4" O.C. AS SHOWN.
3. FOR GROOVE DETAILS SEE 13C-1.
4. 1 PINT LAMP BACK PER CUBIC YARD
5. IF CONSTRUCTING NEW CURB RAMP IN EXISTING CURB, GUTTER AND SIDEWALK, SAWCUT AC PAVEMENT AND REMOVE. REPLACE WITH NEW AC PAVEMENT AFTER CONSTRUCTION OF CURB RAMP, WITH DEEP LIFT IN 3" LAYERS TO A TOTAL MINIMUM DEPTH OF 6" OR TO EXISTING THICKNESS PLUS AN ADDITIONAL 1", WHICHEVER IS GREATER.
6. RAMPS INSTALLED ON A CORNER WITH A RADIUS CURB SHALL HAVE THE WARNING SURFACE MEET THE RADIUS AT END CORNERS OF THE WARNING PANEL. THE PANEL SHALL NOT BE CUT AND SHALL REMAIN INTACT.

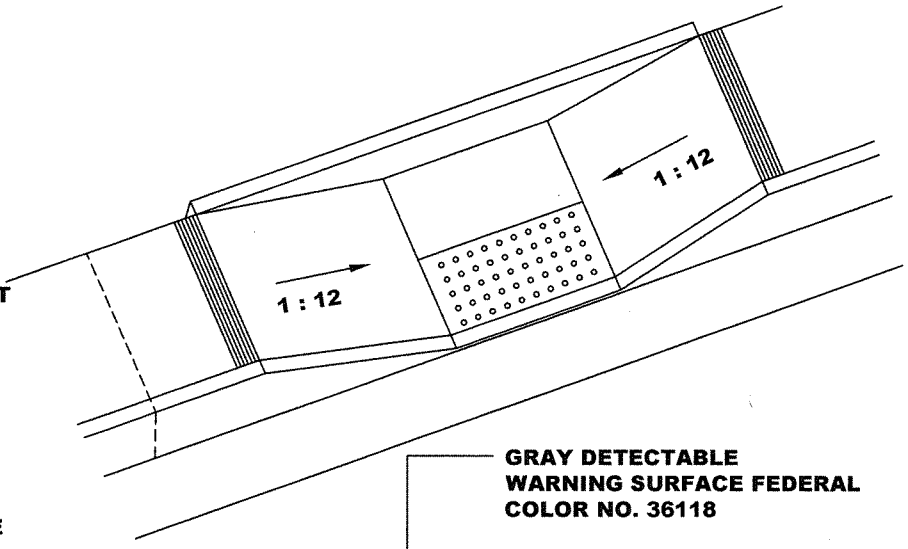

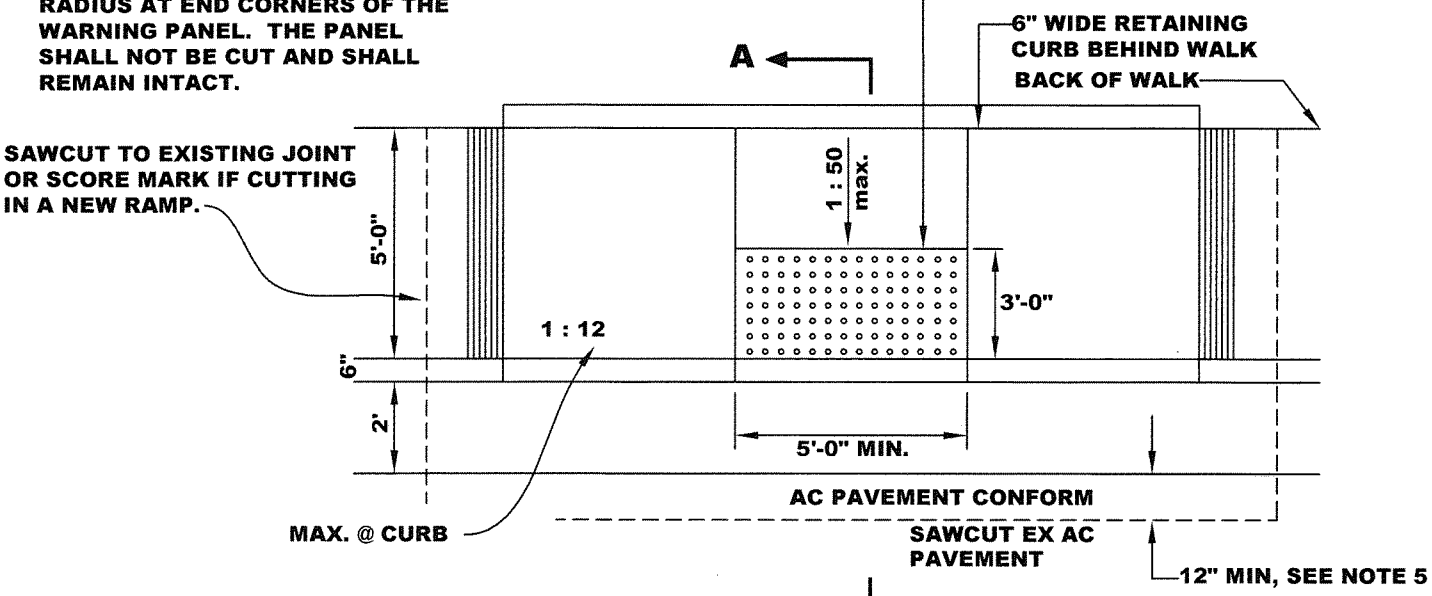

PLAN VIEW

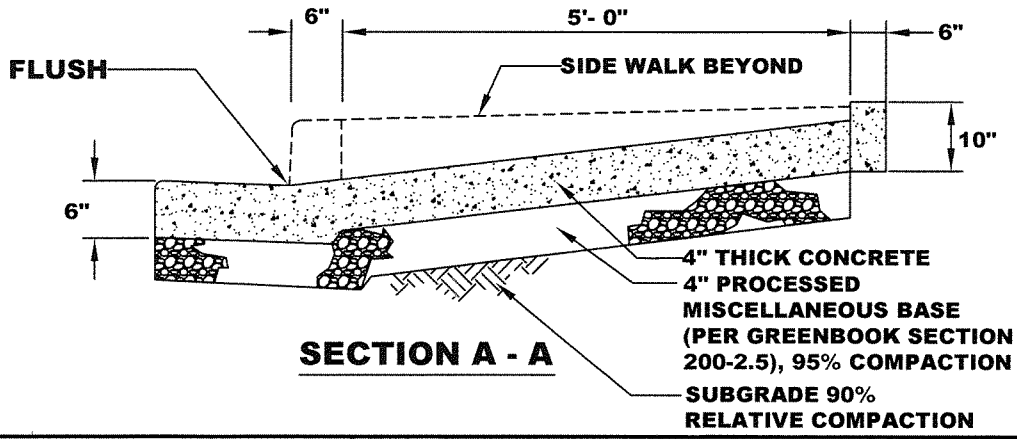

SECTION A - A

PARALLEL CURB RAMP MONOLITHIC SIDEWALK	APPROVED BY:	
	DATE : JUNE 30, 2006 REVISED : JULY, 2013	DWG. 13C-2

2006 STANDARD DETAILS