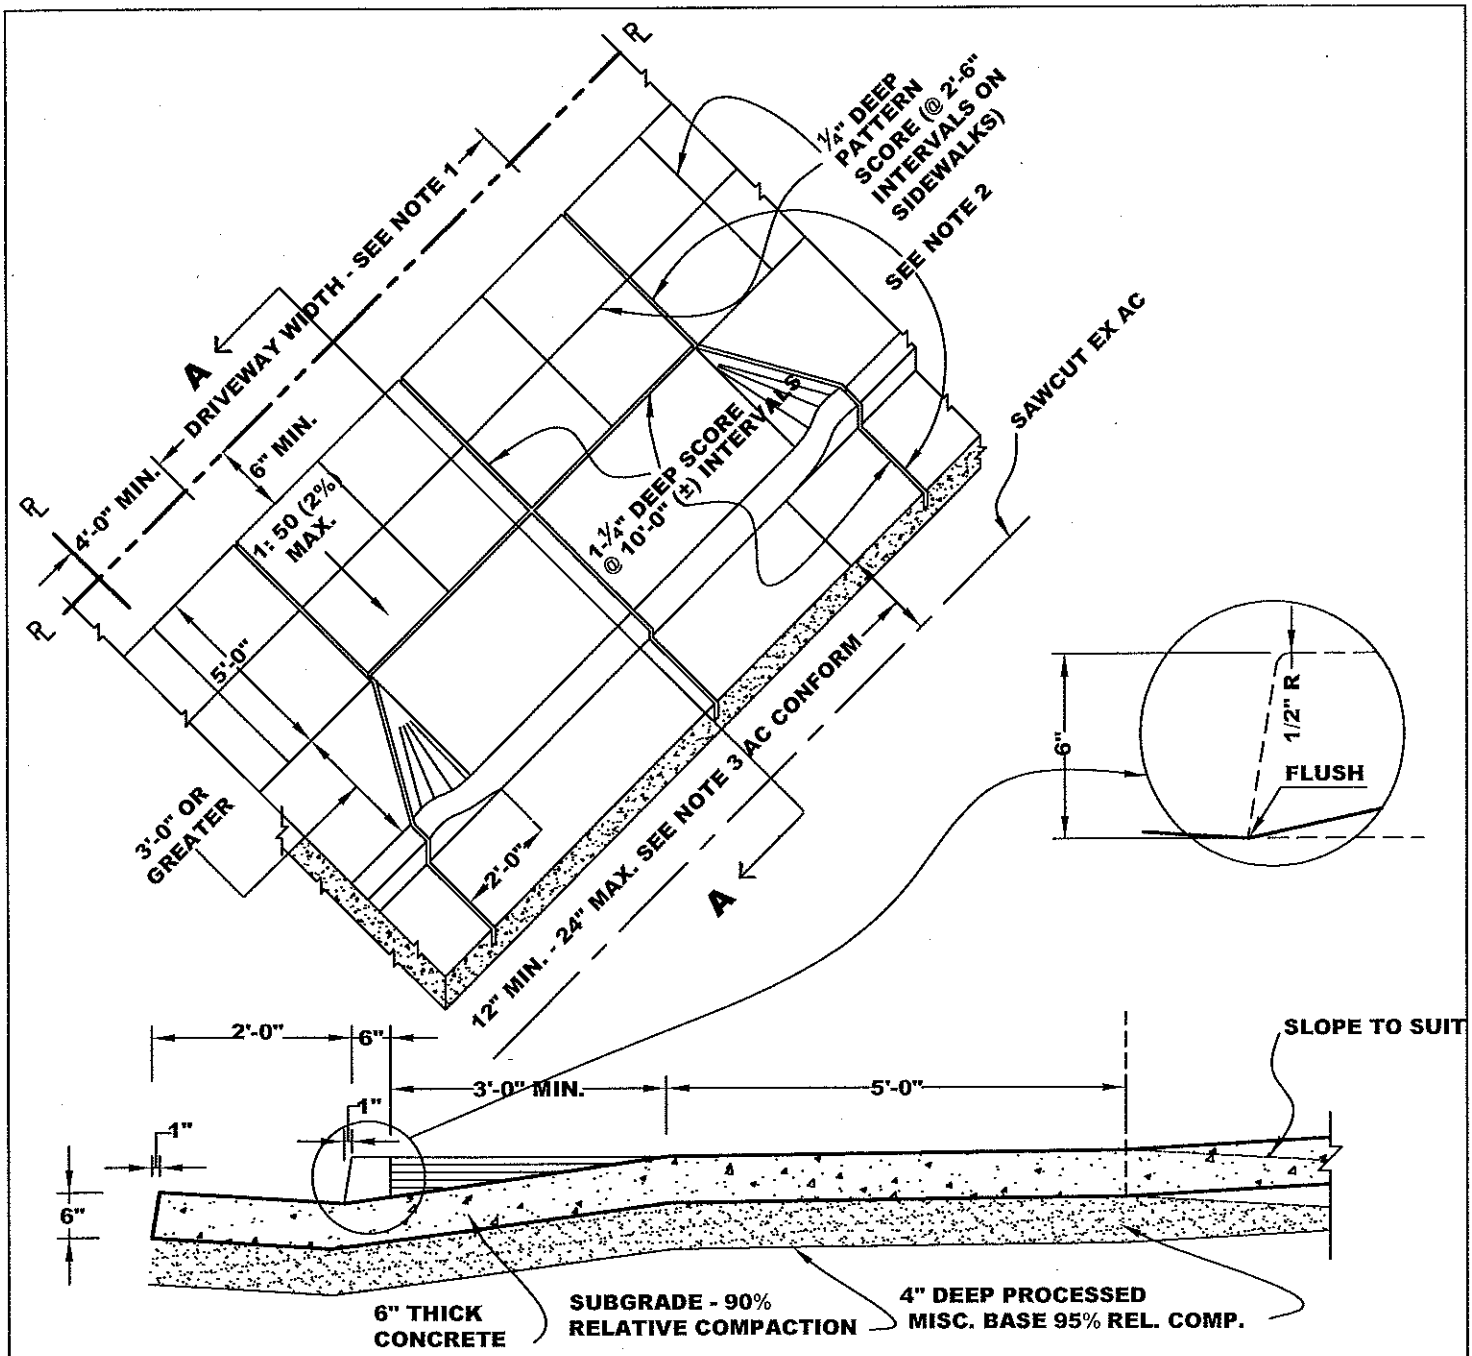

NOTES:

1. DRIVEWAY WIDTH. SINGLE 10'-0" MIN,15'-0" MAX. DOUBLE 17'-6" MIN, 25'-0" MAX. WIDTH INCREMENTS SHALL BE IN MULTIPLES OF 2'-6". NOTE THAT FOR REQUIRED FIRE LANES, MINIMUM WIDTHS MAY BE GREATER.
2. IF CONSTRUCTING NEW DRIVEWAY IN EXISTING CURB, GUTTER & SIDEWALK, SAWCUT TO NEAREST SCORED JOINT OR CONTROL JOINT.
3. IF CONSTRUCTING NEW DRIVEWAY IN EXISTING CURB, GUTTER & SIDEWALK, SAWCUT AC & REMOVE. REPLACE WITH NEW AC AFTER CONSTRUCTION OF DRIVEWAY. AC THICKNESS = 6" MIN.; 12" MAX. ON ARTERIALS.
4. LIGHT BROOM FINISH ALL SURFACES. USE 1PT LAMPBLACK PER CY
5. MATCH EXISTING SCORE PATTERNS OR EXISTING JOINTS IN SIDEWALK. SOME VARIATION IN DIMENSIONING IS PERMITTED, PROVIDED SPECIFIED MAX / MIN SLOPES/DIMENSIONS ARE NOT VIOLATED.

RESIDENTIAL DRIVEWAY APPROACH IN NON MONOLITHIC CURB, GUTTER AND SIDEWALK,WITH PARK-STRIP GREATER THAN 3'-0" WIDE

APPROVED BY:

DATE: JUNE 30, 2006
REVISED: JULY 30, 2009

DWG. 5C-5